
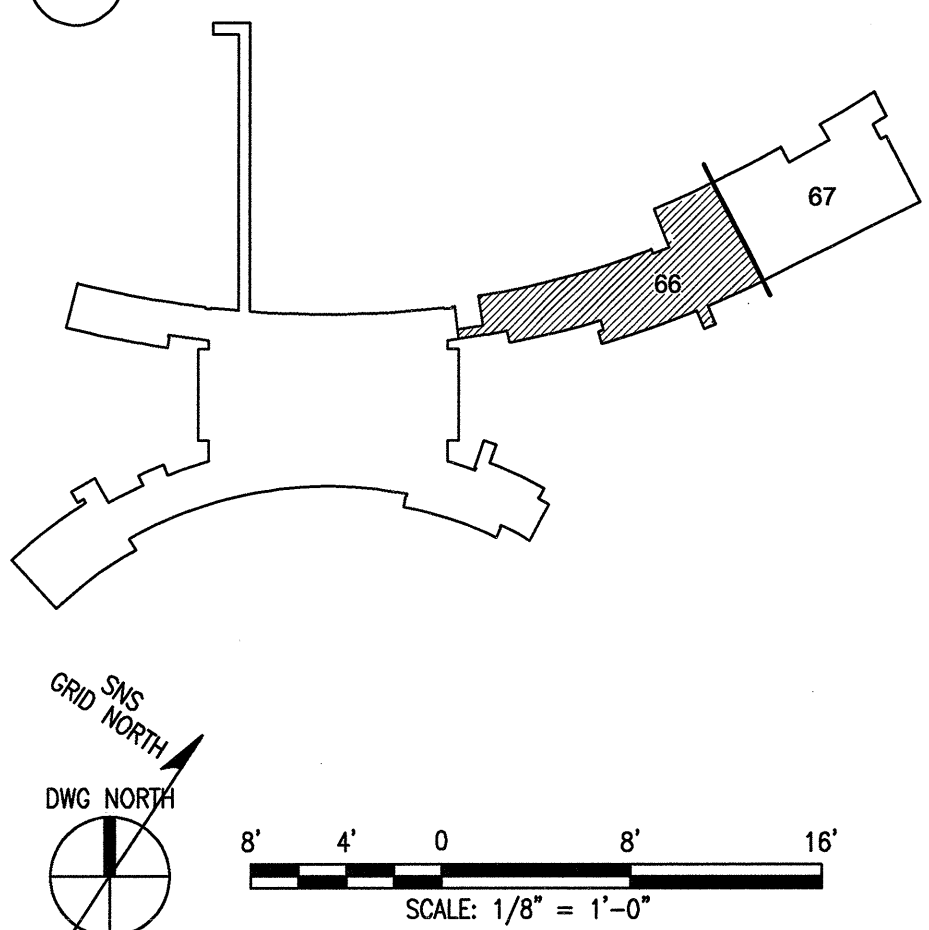


NO01 PROVIDE LIGHTNING PROTECTION GROUND ROD WITH CONNECTIONS AS SHOWN.

NO02 #4/0 SBC TO GROUND BAR ASSEMBLY, SEE 

NO03 #4/0 SBC TO STORAGE TANK LOCATION. PROVIDE 10' COILED CABLE LENGTH FOR CONNECTION TO FUTURE TANK.

NO04 #4/0 SBC TO TRANSFORMER.

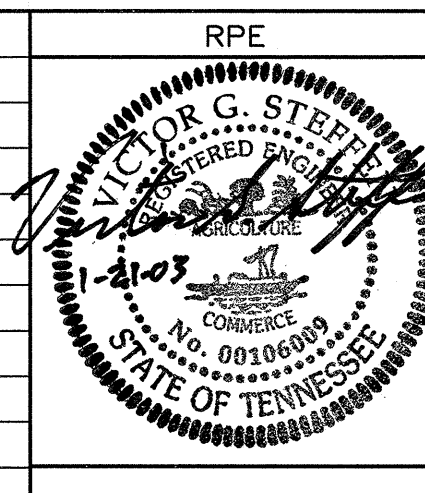


UT-BATTELLE

PROJECT NAME:
CENTER FOR NANOPHASE MATERIALS SCIENCES
ELECTRICAL GROUNDING PLAN
LEVEL B1 - SECTOR 66

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLAS
3	E	X	X	8	8610		1	1	P	U
51	52	53	A/E DRAWING NUMBER:					E7.B1.66		REV
NC	NA									0

THIS DOCUMENT
CONTROLLED BY
CHANGE CONTROL
SYSTEM _____
ENGINEERING
PROCEDURE _____

[illegible]

DSN	C. RUNING	12/09/0
DRW	L. MAKOVSKY	12/09/0
CHK	V. STEFFEN	12/09/0
DEPT		
PE	CLG <i>R. Hansen</i>	1/24/0
PJ	JS <i>M. J. Moore</i>	1/23/0
REQ	<i>R. H. Harte</i>	1/24/0
UTB		
APPROVALS		